


# S-LED-I: Ampio lighting bus current driver

Document number: PO-053-EN Version: 1.0.1 Date of publication: January 12, 2023



## Technical data

### Supply voltage

11 – 16V DC

### Current consumption

6mA\*

### Maximum current of the current outputs load

1A

### Maximum rated voltage of the current output load

12V DC

## Dimensions

### Width

40mm

### Height

20mm

### Depth

16mm

## Environment

### Temperature

-40 – 50°C

### Humidity

≤95%RH, non-condensing

The image above is for illustration purpose only. The actual module may vary from the one presented here.

\* The value does not take into account the current drawn by connected loads.

## General features

Module S-LED-I is a component of the Ampio system. Required voltage to power the module is 11 – 16V DC. The module is controlled via OWA lighting bus.

The module acts as an OWA lighting bus node driver and allows for smooth brightness adjustment of current-controlled LED lighting with a maximum current consumption of 1A and rated voltage not exceeding 12V DC.

In order to ensure optimal working conditions of the device's converter and to maximise the resolution of the useful control range, the maximum output current of each module is adjusted to the customer's needs.

When ordering the module, the expected value of the maximum load current should be specified.

## OWA lighting bus

The OWA lighting bus (One Wire Ampio) is a solution dedicated to controlling LED lighting. Each bus segment contains a controller and up to 16 lighting node drivers or LED lamps with integrated drivers. From the controller level, it is possible to smoothly adjust the brightness of light sources connected to each of the controllers. It is possible to control sets of light points or individual lights independently. It is also possible to implement the so-called *staircase effect*, i.e. smooth brightening and dimming of consecutive light points along the stairs, driveway, etc.

The OWA lighting bus consists of two wires - a ground wire and a wire that ensures communication between the controller and the drivers of a lighting node. Lighting node drivers also require a power line, hence the OWA bus is usually run with a three-wire cable.

With the use of several power lines, it is possible to connect to a single segment of the OWA bus lighting node drivers powered by different voltages. In such a case, however, care should be taken to properly equalise the ground potentials of each of the power supplies, i.e. to connect the grounding of the power supplies.

## Typical application

- Controlling the brightness of current-controlled LED lighting.

## Installation

The module is designed to retrofit LED lamps from other manufacturers to work with the OWA lighting bus.

The small size of the module means that, in many cases, it can be installed inside the luminaire's cover.

The module has two connectors with screw terminals. One of them allows for the connection of the module to the power supply and to the OWA lighting bus. The second of the connectors is intended for connecting a current-controlled LED light source.

The S-LED-I module has no housing, therefore it should be installed in a way that prevents accidental short circuits.

When installing the module, protect the module against accidental short-circuiting between exposed electronic components.


## Programming

The operation logic of lighting bus drivers is entirely imposed by the configuration of the controller supervising the given bus segment. Hence, the drivers themselves are not subject to programming, and all related configuration activities are carried out by the appropriate lighting bus controller.

## Module dimensions

Dimensions expressed in millimeters.

The dashed lines mark the areas where the device connectors or its other elements can be located. In the actual module, connectors may be located in a different place than in the figure below, but within the marked area.

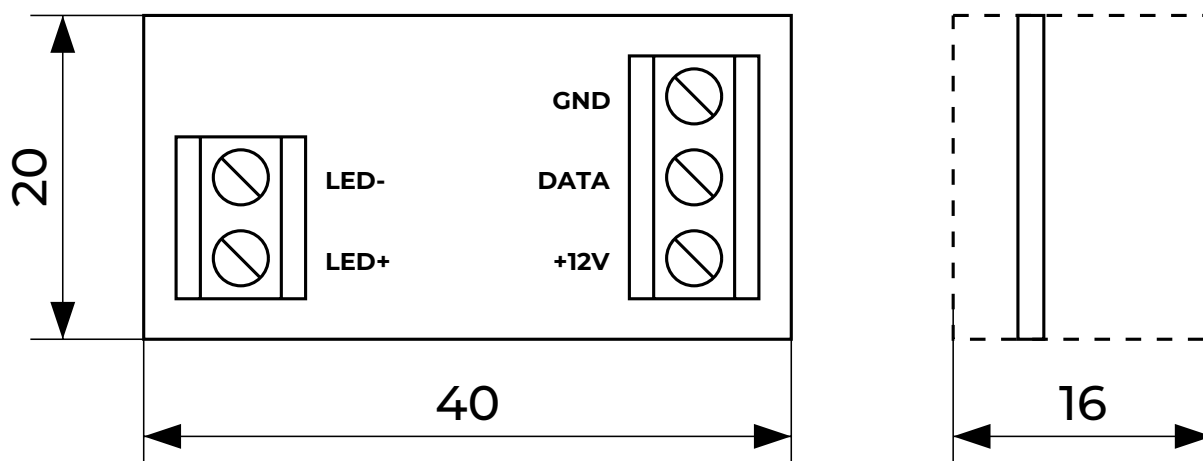

# Connection diagram

The location of the device connectors on the connection diagram is indicative - in the physical module their location may be different.

